



water

and the power of uv light

Your 2013 Drinking Water Test Results
Massachusetts Water Resources Authority

<p>This report contains very important information about your drinking water. Please translate it, or speak with someone who understands it.</p> <p>Si usted desea obtener una copia de este reporte en español, llámenos al teléfono 617-788-1190.</p> <p>La relazione contiene importanti informazioni sulla qualità dell'acqua della Comunità. Tra-durlo o parlarne con un amico che lo comprenda.</p> <p>O relatório contém informações importantes sobre a qualidade da água da comunidade. Traduza-o ou peça a alguém que o ajude a entendê-lo melhor.</p> <p>Sprawozdanie zawiera ważne informacje na temat jakości wody w Twojej miejscowości. Poproś kogoś o przelimitowanie go lub porozmawiaj z osobą która je dobrze rozumie.</p> <p>يحتوي هذا التقرير على معلومات هامة عن نوعية مياه الشرب في منطقتك يرجى ترجمته، أو ابحت التقرير مع صديق لك يفهم هذه المعلومات جيداً.</p> <p>Η κατανόηση αναφοράς παραπομπών σταυρώσεις πληροφορίες για το ποσίο νερό σας. Πρακτικά να το μεταφράσετε ή να το εξηγήσετε με κάποιον που το καταλαβαίνει ακολούτως.</p>	<p>Im Bericht steht wichtige Information über die Qualität des Wassers Ihrer Gemeinschaft. Der Bericht soll übersetzt werden, oder sprechen Sie mit einem Freund, der ihn gut versteht.</p> <p>这份报告中有些重要的信息。讲到关于您所在社区的水的品质。请您找人翻译一下。或者请能看得懂这份报告的朋友给您解释一下。</p> <p>この資料には、あなたの飲料水についての大切な情報が書かれています。内容をよく理解するために、日本語に翻訳して読むか説明を受けてください。</p> <p>इस रिपोर्ट में "पीने के पानी" के विषय पर बहुत जरूरी जानकारी दी गई है। कृपया इसका अनुवाद करें/जिसे, या किसी जानकारी से इस बारे में पूछिए।</p> <p>ရေထက်သာလျှံစေမည့်အရေးကြီးသော အချက်အလက်များကို အသိပေးရန် ဖွဲ့စည်းထားသည့် အဖွဲ့များက ရေးသားထားပါသည်။</p> <p>이 보고서에는 귀하가 거주하는 지역의 수질에 관한 중요한 정보가 들어 있습니다. 이것을 번역하거나 충분히 이해하시는 친구와 상의하십시오.</p> <p>Bản báo cáo có ghi những chi tiết quan trọng về phẩm chất nước trong cộng đồng quý vị. Hãy nhờ người thông dịch, hoặc hỏi một người bạn biết rõ về vấn đề này.</p>
---	---



Massachusetts Water Resources Authority
and Your Local Water Department

This report is required under the Federal Safe Drinking Water Act. MWRA PWS ID# 6000000

Where To Go For Further Information

Massachusetts Water Resources Authority (MWRA)	www.mwra.com	617-242-5323
Massachusetts Dept. of Environmental Protection	www.mass.gov/dep	617-292-5500
Department of Conservation and Recreation	www.mass.gov/dcr/watersupply.htm	617-626-1250
Massachusetts Dept. of Public Health (DPH)	www.mass.gov/dph	617-624-6000
US Centers for Disease Control & Prevention (CDC)	www.cdc.gov	800-232-4636
List of State Certified Water Quality Testing Labs	www.mwra.com/04water/html/testinglabs.html	617-242-5323
Source Water Assessment and Protection Reports	www.mwra.com/sourcewater.htm	617-242-5323
Information on Water Conservation	www.mwra.com/conservation.html	617-242-SAVE

Public Meetings

MWRA Board of Directors	www.mwra.com/02org/html/boardofdirectors.htm	617-788-1117
MWRA Advisory Board	www.mwraadvisoryboard.com	617-788-2050
Water Supply Citizens Advisory Committee	www.mwra.com/02org/html/wscac.htm	413-213-0454



For a large print version, call 617-242-5323.



MWRA BOARD OF DIRECTORS

Richard K. Sullivan, Jr., Chairman

John J. Carroll, Vice-Chair

Joseph C. Foti, Secretary

Joel A. Barrera

Kevin L. Cotter

Paul E. Flanagan

Andrew M. Pappastergion

Brian R. Swett

Henry F. Vitale

John J. Walsh

Jennifer L. Wolowicz

Dear Customer,

I am pleased to share with you the results of our water quality testing. MWRA takes hundreds of thousands of tests each year, and for 2013, we again met every federal and state drinking water standard. System-wide, we have been below the Lead Action Level for the past ten years. Please read your community's letter on page 4 for more information on your local water system.

The big news this year is that we have completed the start-up of a new ultraviolet (UV) disinfection facility at the John J. Carroll Water Treatment Plant in Marlborough, improving the quality of the drinking water we deliver to you.

UV light is essentially a more potent form of natural disinfection from sunlight. UV enables MWRA to inactivate the most difficult to kill pathogens - which could potentially be in the source water - without the use of additional chemicals or any associated disinfection by-products. The UV process and MWRA's high quality source water allow MWRA to meet new regulatory requirements cost effectively.

Since 2005, your water has been treated with ozone - produced by applying an electrical current to pure oxygen. Ozone provides a high level of protection against microbes and viruses, improves water clarity, and has actually made the water taste better. The addition of UV to the ozone process provides additional assurance that any pathogens potentially in our reservoirs will be rendered harmless.

In addition, fluoride is added to promote dental health and the water chemistry is adjusted to reduce corrosion of lead and copper from home plumbing. Last, we add monochloramine, a mild and long-lasting disinfectant combining chlorine and ammonia to protect the water as it travels through miles of pipelines to your home.



In a few short years, water treatment has gone from chlorine with its taste and odor issues, to ozone and now ultraviolet light- with no additional chemicals and no disinfection by-products. Just better, safer water.

Your local water supply may have different treatment. Please see page 4 for more information.

I hope you will take a few moments to read this report. We want you to have the same confidence we have in the water we deliver to over 2 million customers. Please contact us if you have any questions or comments about your water quality, or any of MWRA's programs.

Sincerely,

Frederick A. Laskey
Frederick A. Laskey
Executive Director

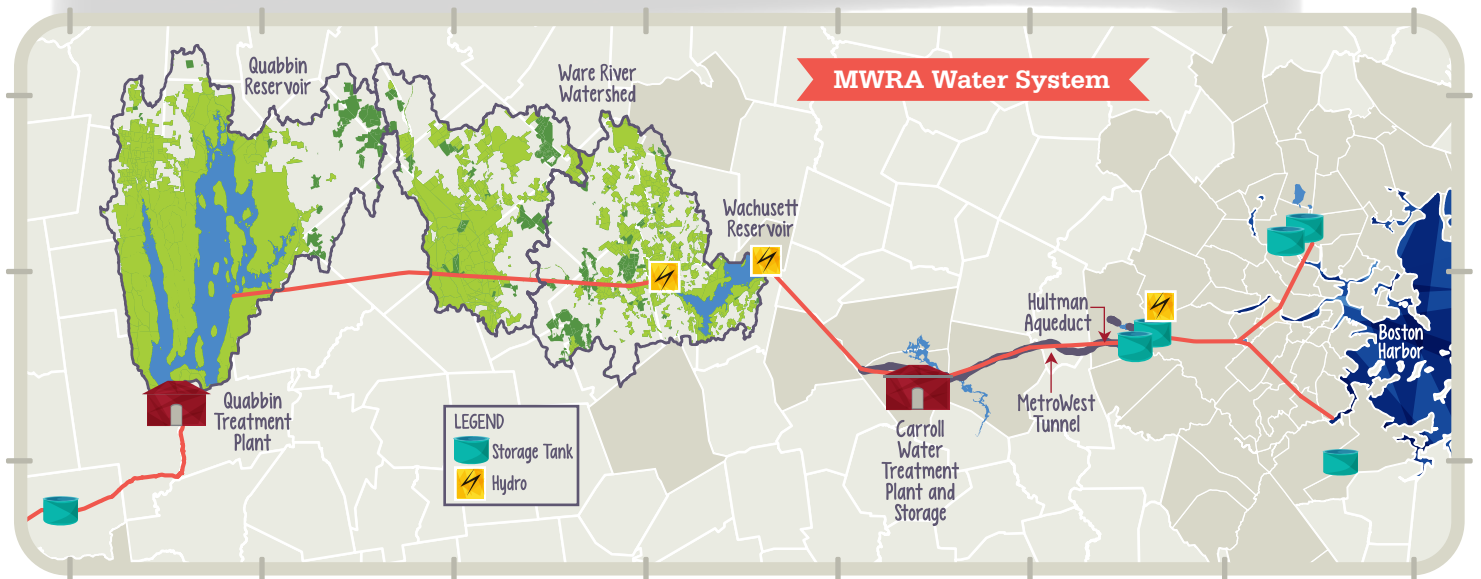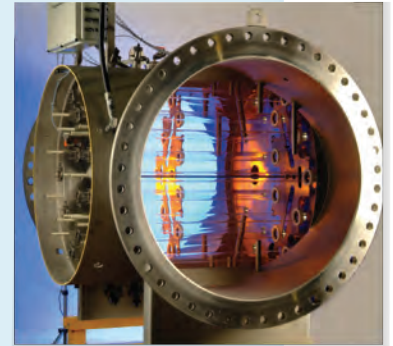



Where Does Your Water Come From?

Your water comes from the Quabbin Reservoir, about 65 miles west of Boston, and the Wachusett Reservoir, about 35 miles west of Boston. These reservoirs supply wholesale water to local water departments in 51 communities. The two reservoirs combined supplied about 200 million gallons a day of high quality water to consumers in 2013. Your water also comes from local water supplies. Please see page 4 for more information.

The Quabbin and Wachusett watersheds are naturally protected with over 85% of the watersheds covered in forest and wetlands. To ensure safety, the streams and reservoirs are tested often and patrolled daily by the Department of Conservation and Recreation (DCR).

Rain and snow falling on the watersheds - protected land around the reservoirs - turn into streams that flow to the reservoirs. This water comes in contact with soil, rock, plants, and other material as it follows its natural path to the reservoirs. While this process helps to clean the water, it can also dissolve and carry very small amounts of material into the reservoir. Minerals from soil and rock do not typically cause problems in the water. But, water can also transport contaminants from human and animal activity. These can include bacteria and viruses - some of which can cause illness. The test data in this report show that these contaminants are not a problem in your reservoirs' watersheds. The Department of Environmental Protection (DEP) has prepared a Source Water Assessment



Program report for the Quabbin and Wachusett Reservoirs. The DEP report commends DCR and MWRA on the existing source protection plans, and states that our “watershed protection programs are very successful and greatly reduce the actual risk of contamination.” MWRA follows the report recommendations to maintain the pristine watershed areas using existing watershed plans. Your water also comes from local supplies that have a separate report.

Testing Your Water – Every Step of the Way

Test results show few contaminants are found in the reservoir water. The few that are found are in very small amounts, well below EPA's standards.

Turbidity (or cloudiness of the water) is one measure of overall water quality. All water must be below 5 NTU (Nephelometric Turbidity Units), and water can only be above 1 NTU if it does not interfere with effective disinfection. Typical levels at the Wachusett Reservoir are 0.3 NTU. In 2013, turbidity was below 1 NTU over 99.99% of the time, with the highest level at 1.17 NTU. This did not interfere with effective disinfection.

MWRA also tests reservoir water for pathogens such as fecal coliform, bacteria, viruses, and the parasites *Cryptosporidium* and *Giardia*. They can enter the water from animal or human waste. No *Cryptosporidium* or *Giardia* was found in the water in 2013.

Test Results – After Treatment

EPA and state regulations require many water quality tests after treatment to check the water you are drinking. MWRA conducts hundreds of thousands of tests per year on over 120 contaminants (a complete list is available on www.mwra.com). For results on your local water supply, please see page 4. Details about 2013 test results are in the table below. The bottom line is that water quality is excellent.

Water Quality Test Results for 2013

Compound	Units	(MCL) Highest Level Allowed	(We found) Detected Level-Average	Range of Detections	(MCLG) Ideal Goal	Violation	How it gets in the water
Barium	ppm	2	0.008	0.007-0.009	2	No	Common mineral in nature
Monochloramine	ppm	4-MRDL	1.8	0.01-4.0	4-MRDLG	No	Water disinfectant
Fluoride	ppm	4	1.04	0.37-1.1	4	No	Additive for dental health
Nitrate [^]	ppm	10	0.08	0.01-0.08	10	No	Atmospheric deposition
Nitrite [^]	ppm	1	0.005	ND-0.005	1	No	Byproduct of water disinfection
Total Trihalomethanes	ppb	80	10.1	3.0-13.9	ns	No	Byproduct of water disinfection
Haloacetic Acids-5	ppb	60	9.0	1.4-13.2	ns	No	Byproduct of water disinfection
Total Coliform	%	5%	0.5% (Nov)	ND-0.5%	0	No	Naturally present in environment

KEY: MCL=Maximum Contaminant Level. The highest level of a contaminant allowed in water. MCLs are set as close to the MCLGs as feasible using the best available technology. MCLG=Maximum Contaminant Level Goal. The level of contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety. MRDL=Maximum Residual Disinfectant Level. The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants. MRDLG=Maximum Residual Disinfectant Level Goal. The level of a drinking water disinfectant below which there is no known or expected health risk. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contamination. ppm=parts per million ppb=parts per billion ns=no standard [^]As required by DEP, the maximum result is reported for nitrate and nitrite, not the average.

Tests in Community Pipes

MWRA and local water departments test 300 to 500 water samples each week for total coliform bacteria. Total coliform bacteria can come from the intestines of warm-blooded animals, or can be found in soil, plants, or other places. Most of the time, they are not harmful. However, their presence could signal that harmful bacteria from fecal waste may be there as well. The EPA requires that no more than 5% of the samples in a month may be positive. If a water sample does test positive, we run more specific tests for *E. coli*, which is a bacteria found in human and animal fecal waste and may cause illness. If your community found any total coliform, it will be listed within the community letter on page 4.

Research for New Regulations

MWRA has been working with EPA and other researchers to define new national drinking water standards by testing for unregulated contaminants. To read more about this testing, and to see a listing of what was found, please visit www.mwra.com/UCMR/2013.html.

Drink Local and Be Green

Tap water is delivered straight to your home without trucking or plastic waste. Bottled water produces over 10,000 times the amount of greenhouse gases compared to tap water. Half of our energy needs for water and wastewater treatment are met with green power including hydro-energy, wind turbines, and solar panels.

Drink local! Drink tap water! Be green!



Drinking Water and People with Weakened Immune Systems

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the EPA's Safe Drinking Water Hotline (1-800-426-4791).

Contaminants in Bottled Water and Tap Water

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline (1-800-426-4791) or MWRA. In order to ensure that tap water is safe to drink, the Massachusetts DEP and EPA prescribe regulations which limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) and the Massachusetts Department of Public Health regulations establish limits for contaminants in bottled water which must provide the same protection for public health.


Information About Cross Connections

Massachusetts DEP recommends the installation of backflow prevention devices for inside and outside hose connections to help protect the water in your home as well as the drinking water system in your town. For more information on cross connections, please call 617-242-5352 or visit www.mwra.com/crosscon.html.

Your Tap Water – Award Winning and Affordable!

In 2013, we won **New England's Best-Tasting** water award from the New England Water Works Association and the **National Sustainability Award** from the American Council for an Energy-Efficient Economy. Great tasting, green, and also cheap! Tap water costs less than a penny per gallon delivered straight to your home, while bottled water can cost from \$1 to \$8 a gallon.

Make the smart choice and drink tap water.

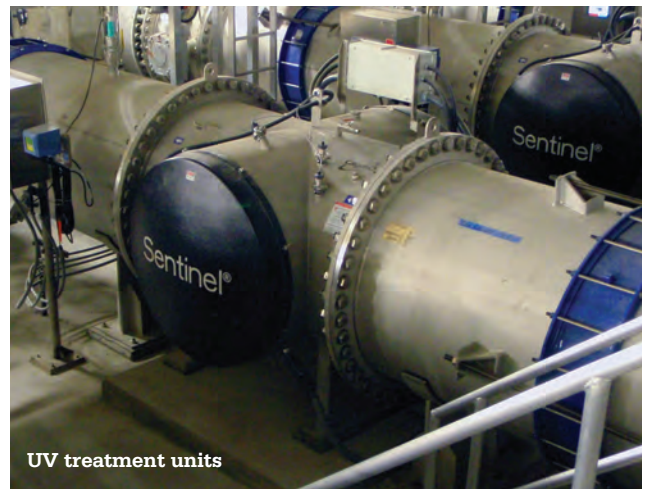

UV treatment units



CITY OF MARLBOROUGH
DEPARTMENT OF PUBLIC WORKS
Water & Sewer Division

135 NEIL STREET * MARLBOROUGH, MA. 01752

508-624-6910 * Fax 508-460-3632

David R. Lavallee
 General Foreman
 Water & Sewer Division

Public Water Supply
 # 2170000

CITY OF MARLBOROUGH WATER SYSTEM
Drinking Water Report

This is an annual report on the quality of water delivered by the City of Marlborough to its residents and businesses. It complies with the Federal Safe Drinking Water Act (SDWA) requirement for “Consumer Confidence Reports” and contains information on the source of our water, its makeup and health risks associated with any contaminants. Safe water is vital to our community. Please read this report carefully and if you have any questions, call the numbers listed below.

The City of Marlborough’s water supply comes from three sources: Massachusetts Water Resources Authority (MWRA), Lake Williams and Millham Reservoir. During calendar year 2013, the City of Marlborough Department of Public Works supplied 1.67 billion gallons of water for use by our customers.

Pursuant to the SDWA, the City of Marlborough is required to monitor its drinking water on a regular basis for specific man-made and naturally occurring contaminants. Results of regular monitoring are an indicator of whether or not our drinking water meets applicable health standards. Testing results for 2013, show the city in compliance with lead and copper limits. The city plans to continue its incentive program to encourage participation by residents in our sampling program, its program for removing lead service pipes as part of our street reconstruction projects, and treating its drinking water to keep the lead and copper limits below the maximum contaminant levels.

Water Quality Table

The Water Quality Table below provides information on the results of the city’s testing program and is based upon samples taken during 2013. Terms used in the table are defined below or within the table itself.

Regulated Contaminants	Date(s) Collected	Result or Highest RAA*	Range	MCL	MCLG	Violation (Y/N)	Possible Sources
Inorganic Contaminants							
Nitrate (ppm)	4/10/13	0.28	--	10	10	N	Runoff from fertilizer use; erosion of natural deposits
Barium (ppm)	4/10/13	0.027	--	2	2	N	Erosion of natural deposits
Fluoride (ppm)	4/10/13	1	--	4**	4	N	Water additive that promotes strong teeth
Disinfectants and Disinfection Byproducts							
Haloacetic Acids (HAA5s) (ppb)	Quarterly In 2013	18*	9 - 31	60	--	N	By-products of drinking water chlorination
Total Trihalomethanes (TTHMs) (ppb)		49*	11 - 53	80	--	N	
Total Chlorine (ppm)	42 Samples per Month	2.21*	0.16 – 3.6	4	4	N	Water additive used to control microbes

MARLBOROUGH DPW -- 2013 FINISHED WATER TEST RESULTS

* Highest RAA= highest running annual average over four consecutive quarters.

** Fluoride also has an SMCL of 2 ppm.

Lead and Copper	Date(s) Collected	90 th Percentile*	Action Level	MCLG	# of sites sampled	# of sites above AL	Exceeds AL (Y/N)	Possible Sources
Lead (ppb)	6/30/13 10/23/13	18 7.8	15	0	61 60	11 3	Y N	Corrosion of household plumbing
Copper (ppm)	6/30/13 10/23/13	0.079 0.077	1.3	1.3	61 60	0 0	N N	Corrosion of household plumbing

* Nine out of every 10 homes sampled were at or below this level. This number is compared to the action level for each contaminant.

Unregulated and Secondary Contaminants	Date Collected	Result	SMCL	ORSG	Possible Sources
Nickel (ppm)	4/10/13	1.5	--	100	Natural sources
Sodium (ppm)	4/10/13	180	--	20*	Natural sources; runoff from road salt
Iron (ppb)	4/10/13	54	300	--	Natural sources; corrosion of cast iron pipes
Manganese (ppb)	4/10/13	75	50	300**	Erosion of natural deposits

* Sodium-sensitive individuals, such as those experiencing hypertension, kidney failure or congestive heart failure should be aware of the levels of sodium in their drinking water where exposures are being carefully controlled.

** US EPA and MassDEP have established health advisory levels for manganese to protect against concerns of potential neurologic effects.

Turbidity is a measure of the cloudiness of the water. We monitor it because it is a good indicator of the effectiveness of our filtration system.					
Turbidity	MCL	Lowest Monthly % of Samples < 0.3 NTU	Highest Detected Daily Value	Violation (Y/N)	Possible Source of Contamination
Turbidity (NTU)	1	-----	0.74	N	Soil runoff
Monthly Compliance*	At least 95% < 0.3 NTU	100	-----	N	
*Monthly turbidity compliance is related to a specific treatment technique (TT). This treatment facility filters the water so at least 95% of our samples each month must be below the turbidity limits specified in the regulations.					

Definitions

MCL = Maximum Contaminant Level. The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG = Maximum Contaminant Level Goal. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

AL = Action Level. The AL is the concentration of a contaminant, which, if exceeded, triggers treatment or other requirements that a water system must follow.

ppm = parts per million, or milligrams per liter (mg/l)

ppb = parts per billion, or micrograms per liter (µg/l)

NTU = Nephelometric turbidity unit

Unregulated Contaminants = Unregulated contaminants are substances without MCLs for which EPA requires monitoring. For some of these substances, the Massachusetts Office of Research and Standards (ORS) have developed state guidelines or secondary MCLs.

SMCL = Secondary Maximum Contaminant Level. These standards are developed to protect the aesthetic qualities of drinking water and are not health based.

ORSG = Office of Research and Standards Guideline. This is the concentration of a chemical in drinking water, at or below which, adverse health effects are unlikely to occur after chronic (lifetime) exposure. If exceeded, it serves as an indicator of the potential need for further action.

Although many tests were run on a number of contaminants, only those substances listed above were detected. The water was tested for *Giardia* and *Cryptosporidium* and were not found.

The state recommended per capita water use is 65 gallons per person per day. In order to achieve this value, we encourage all residents to use water more efficiently. Please visit the Marlborough Department of Public Works website for tips on water conservation at www.marlborough-ma.gov.

Lead and Copper Non Compliance

The City of Marlborough was above the Action Level for testing on Lead during for the 2nd quarter sampling in 2013. Marlborough passed the 4th quarter sampling for Lead and Copper however in 2013.

Water System Compliance

The City was placed under an Administrative Consent Order (ACO) by MassDEP in April, 2014 to bring the City's water system into compliance with the federal Long Term 2 Enhanced Surface Water Treatment Rule ("LT2"). The Marlborough Water Division is working to modify the Millham Water Treatment Plant to comply with the new regulations.

A complete design for the installation of the UV system and improvements to the treatment plant will be submitted for review and approval to MassDEP by July 1, 2014. Construction will commence by November 1, 2014 and be complete by September 30, 2015.

Important Information about your Drinking Water-Monitoring Requirements not met for City of Marlborough

Our water system violated several drinking water standards in 2011 and 2012. Even though these were not emergencies, as our customers, you have a right to know what happened and what we did to correct these situations.

We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not our drinking water meets health standards. During 2011 we did not monitor and report for Perchlorate analysis for the Millham Water Treatment Plant. During April through June 2012 and October through December 2012, we did not properly sample from Tier 1 sites as required by the Lead and Copper Rule.

What should I do?

There is nothing you need to do at this time.

Missed Monitoring Requirements

Our water system violated several drinking water monitoring requirements in 2011 and 2012. We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not our drinking water meets health standards.

Marlborough DPW was in non-compliance in 2011 because samples for perchlorate were not taken during the 3rd quarter 2011 as scheduled. The sample was collected during the 4th quarter 2011, and the results were in compliance. It was sampled for in 2012 and 2013 and not detected.

Marlborough DPW was in non-compliance from April-June 2012 and October-December 2012 for lead and copper sampling because 3 of the 60 samples collected were not from Tier 1 sites. Tier 1 sites must have lead water services and 3 of the 60 sites sampled did not have lead service lines.

The table below list the contaminants we did not properly test for during 2011 and 2012, how often we are supposed to samples and how many samples we are supposed to take, how many samples we took, when samples should have been taken and the date on which the follow-up samples were taken.

Contaminant	Required sampling frequency	Number of samples taken	When Samples should have been taken	When samples were taken
Perchlorate	Annually	1	3 rd quarter annually	Taken on 12/15/11
Lead and Copper	Semi-Annual	57 Tier 1 3 Not Tier 1	2 nd and 4 th quarter 2012	2 nd and 4 th quarter 2012

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

There is also a website for the City of Marlborough Source Water and Assessment Program (SWAP). This is a program established under the Safe Drinking Water Act. This program requires the City of Marlborough to inventory land uses within the recharge areas of all public water supply sources. The program also assesses the susceptibility of drinking water sources to contamination from these land uses and publicizes the results to provide support for improved protection. The Marlborough SWAP Report can be found on the website <http://www.mass.gov/eea/docs/dep/water/drinking/swap/cero/2170000.pdf>

This notice is being sent to you by CCR.

PWS ID# 2170000

For any questions or for further information, please visit the Marlborough DPW at www.marlborough-ma.gov or contact David R. Lavalley, Marlborough Water/Sewer Division General Foreman at 508-624-6910 ext. 7401 or email at dlavalley@marlborough-ma.gov.

What You Need to Know about Lead in Tap Water

MWRA water is lead-free when it leaves the reservoirs. MWRA and local pipes that carry the water to your community are made mostly of iron and steel and do not add lead to the water. However, lead can get into tap water through pipes in your home, your lead service line, lead solder used in plumbing, and some brass fixtures. Corrosion or wearing away of lead-based materials can add lead to tap water, especially if water sits for a long time in the pipes before it is used.

In 1996, MWRA began adding sodium carbonate and carbon dioxide to adjust the water's pH and buffering capacity. This change has made the water less corrosive, thereby reducing the leaching of lead into drinking water. Lead levels found in sample tests of tap water have dropped by almost 90% since this treatment change.

MWRA Meets Lead Standard in 2013

Under EPA rules, each year MWRA and your local water department must test tap water in a sample of homes that are likely to have high lead levels. These are usually homes with lead service lines or lead solder. The EPA rule requires that 9 out of 10, or 90%, of the sampled homes must have lead levels below the Action Level of 15 parts per billion (ppb).

All 18 sampling rounds over the past ten years have been below the EPA standard. Results for the 452 samples taken in September 2013 are shown in the table. 9 out of 10 houses were below 6.3 ppb, which is below the Action Level of 15 ppb. For lead and copper results for your local water supply, see page 4.


September 2013 Lead and Copper Results					
	Range	90% Value	(Target) Action Level	(Ideal Goal) MCLG	% Home Above AL/# Homes Tested
Lead (ppb)	0-46.9	6.3	15	0	8/452
Copper (ppm)	0-0.3	0.1	1.3	0	0/452

KEY: AL=Action Level-The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow. Definition of MCLG available on page 2.



Important Information from EPA about Lead

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. MWRA is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. If your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline at 1-800-426-4791 or www.epa.gov/safewater/lead.

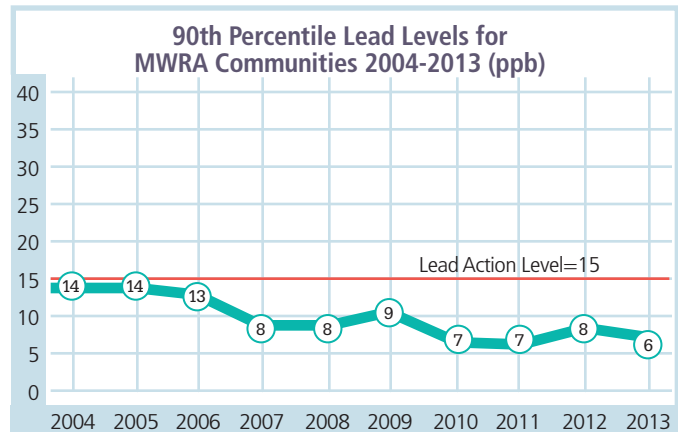

How do I reduce my exposure to lead in drinking water?

Run the tap until after the water feels cold. To save water, fill a pitcher with fresh water and place in the refrigerator for future use.

Never use hot water from the faucet for drinking or cooking, especially when making baby formula or other food for infants.

Ask your local water department if there are lead service lines leading to your home.

Check your plumbing fixtures to see if they are lead-free. Read the labels closely.

Test your tap water. Call the MWRA Drinking Water Hotline (617-242-5323) or visit our website for more tips and a list of DEP certified labs that can test your water.

Be careful of places you may find lead in or near your home. Paint, soil, dust and some pottery may contain lead.

Call the Department of Public Health at 1-800-532-9571 or EPA at 1-800-424-LEAD for health information.