

For more information, please contact MWRA at (617) 242-5323, or visit www.mwra.com.

WATER QUALITY UPDATE An Analysis of July 2005 Sampling Data

MASSACHUSETTS WATER RESOURCES AUTHORITY
100 First Avenue, Charlestown Navy Yard, Boston, MA 02129



MWRA WATER QUALITY UPDATE

July 2005 Highlights

- The new Carroll Water Treatment Plant in Marlborough which supplies water to the distribution system was activated at 11:45pm on July 27. MWRA's integrated water delivery system, including the covered storage tanks, the MetroWest Tunnel and the *John J. Carroll Water Treatment Plant* will help ensure safe drinking water for the approximate 2.3 million people in the 42 metropolitan Boston communities, meeting all current state and federal standards. The plant was officially dedicated as the John J. Carroll Water Treatment Plant on August 18, 2005. See www.mwra.com.
- DBP levels were elevated in July, but still within standards. Contributing factors are higher UV₂₅₄ levels and the higher chlorine doses and high flows needed to support Carroll Water Treatment Plant testing. Quabbin Reservoir water began to arrive at the intake in mid July resulting in somewhat lower UV₂₅₄ and DBP levels. Start-up of the new plant resulted in substantial reductions in chlorinated DBP levels. Initial sampling indicates reductions of over 80%. See page 7.
- The Wachusett Reservoir was treated with copper sulfate on July 22 and 26 to control nuisance algae which can cause taste and odor problems. The treatments were successful. Initial indications are that ozone treatment at the new Carroll Water Treatment Plant is also reducing taste and odor compounds. See Page 4.
- MWRA achieved CT disinfection requirements for the month at the Ware Disinfection Facility (WDF) and the Cosgrove Disinfection Facility (CDF). CT results appear on Page 5. One community violated the Total Coliform Rule criteria. See Page 6.
- For your convenience, and to help save money and paper, you can now receive the monthly *Water Quality Update* on-line instead of via post. Each month, we will send you an e-mail with the highlights and the link to the *Water Quality Update* online on our web-page. Please send an e-mail to Joshua.Das@mwra.state.ma.us if you are interested.

Let us know what you think (617) 242-5323

Release Date: August 20, 2005

Water Quality Update


This is a monthly report containing information about the quality of water supplied by MWRA. It provides a more detailed review of water quality than the annual water quality report that is mailed each June to customers in our service area. The report is available at www.mwra.com.

The Water System

MWRA provides about 250 million gallons of water each day to 46 cities and towns in Massachusetts. Each municipality is responsible for distributing the water within its own community. More than two million people are served by the MWRA water supply system.

Quabbin Reservoir is the primary source of water for our system and one of the country's largest water supply impoundments, with a capacity of 412 billion gallons. Quabbin water represents source water for the Chicopee Valley Aqueduct (CVA) system. Water is transferred from Quabbin Reservoir to the 65 billion gallon Wachusett Reservoir in Clinton via the Quabbin Aqueduct. Wachusett water represents source water for MetroWest and Metropolitan Boston communities. The watershed areas of the Quabbin and Wachusett Reservoirs total 401 square miles. The Department of Conservation and Recreation (DCR), which manages the watersheds, and MWRA are committed to protection of the water supply through aggressive watershed protection as the first line of defense against water contamination. Three-quarters of the watersheds are protected lands and over 80% are either forest or wetlands.

The map below indicates the location of reservoirs, treatment facilities, and service communities.

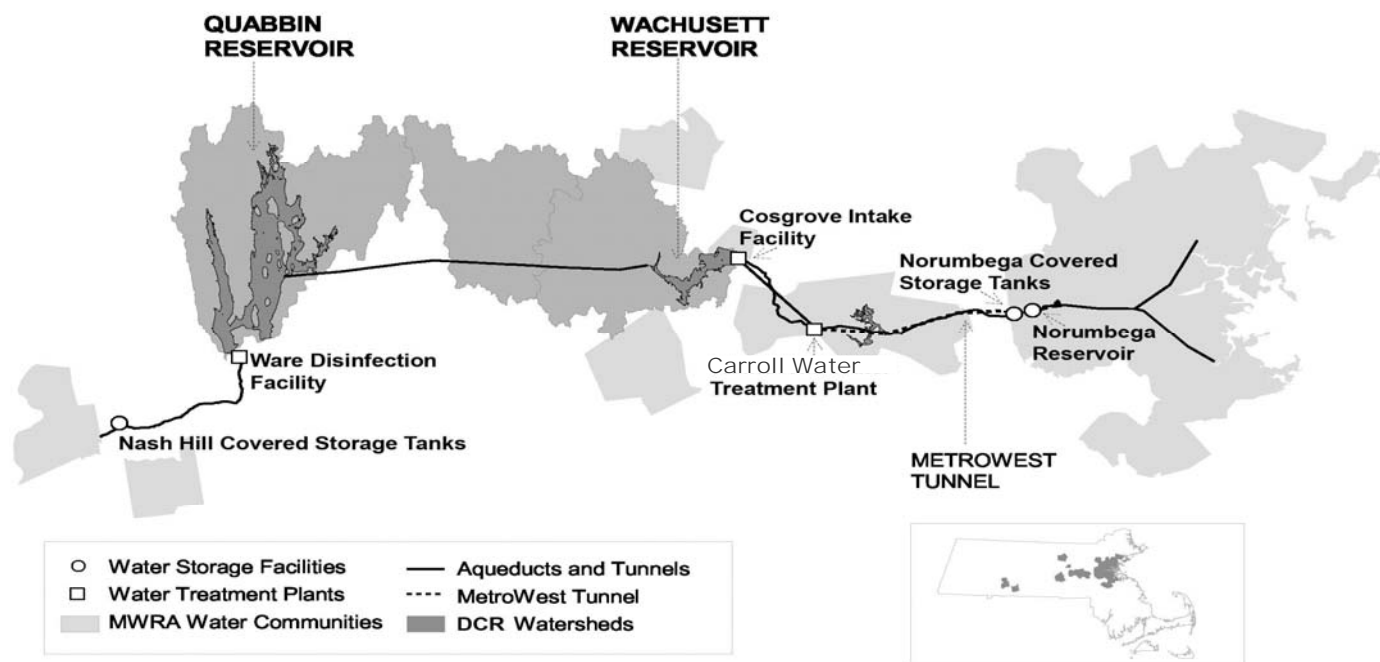

Indicators of Water Quality

Tests are conducted on water sampled at the source reservoirs (source or raw water) and also on water after treatment (treated water). MWRA routinely uses six general indicators of water quality: microbial, corrosiveness, disinfection by-products, turbidity and algae, disinfectant residual, and mineral analysis. Testing frequencies vary by parameter.

The Federal Safe Drinking Water Act (SDWA) sets standards for source and treated water quality. The standards relate to coliform, turbidity, watershed protection, disinfection and disinfection by-products, over 120 potential chemical contaminants, and waterborne disease outbreaks. MWRA monitors for these parameters on schedules ranging from daily to annually.

Customer communities must also meet certain standards under the SDWA concerning distribution of treated drinking water. The Total Coliform Rule (TCR) helps to alert communities to possible microbial contamination as well as the adequacy of residual disinfection within the local distribution system. MWRA tests over 1500 samples per month. Under the SDWA, a violation of the TCR occurs when greater than 5% of the samples in a community are positive for total coliform during a month.

Source Water – Microbial Results

July 2005


Source Water - Microbial Results

Total coliform bacteria are monitored in both source and treated water to provide an indication of overall bacteriological activity. Most coliforms are harmless. Fecal coliform, a subclass of the coliform group, are identified by their growth at temperatures comparable to those in the intestinal tract of mammals. They act as indicators of possible fecal contamination. The Surface Water Treatment Rule for unfiltered supplies requires that no more than 10% of source water samples prior to disinfection over any six-month period have more than 20 fecal coliforms per 100ml.

Sample Site: Quabbin Reservoir

Quabbin Reservoir water is sampled at the Ware Disinfection Facility (WDF) raw water tap before entering the CVA system as of July 13, 2004. Prior samples were collected at Winsor Dam. MWRA met the six-month running average standard for fecal coliform continuously at this location over the last year.


Eight of the 31 samples were positive during July. The samples did not exceed a count of 20 cfu/100ml.

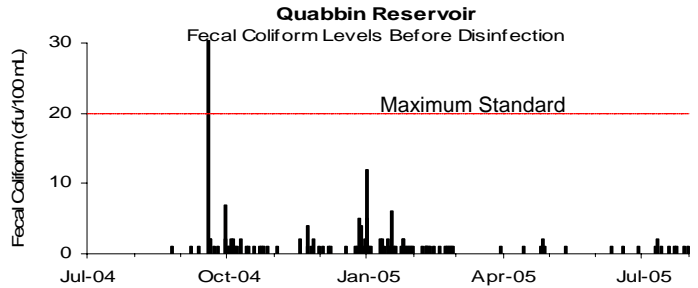

Sample Site: Wachusett Reservoir


Wachusett Reservoir water is sampled before it enters the MetroWest and Metropolitan Boston systems at the Cosgrove Intake.

Fecal coliform levels tend to increase during the winter because, when water bodies near Wachusett ice over, waterfowl seek open water. Many roost at Wachusett, which tends to freeze later in the year than smaller ponds nearby.

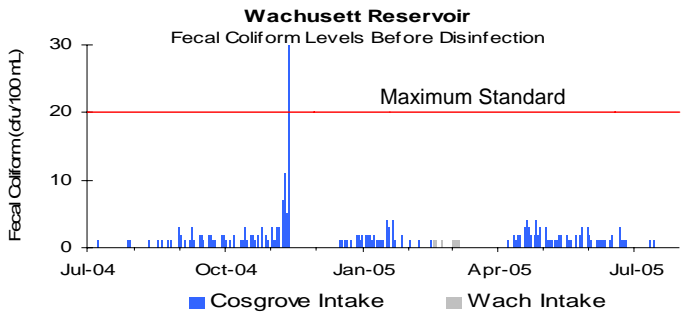

Two of the 21 samples were positive during July. None of the the samples exceed a count of 20 cfu/100ml.


For the current six-month period, 0.0% of the samples have exceeded a count of 20 cfu/100ml

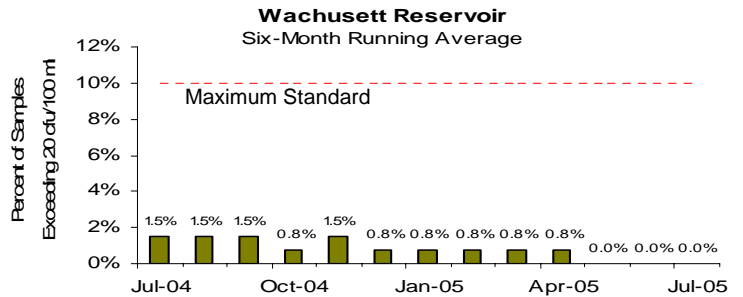

UV

UV-254 is a surrogate measure of reactive organic matter and is a good predictor for DBP levels. Levels are currently around 0.070 A/cm.

The transfer of the Quabbin Reservoir water to the Wachusett Reservoir to lower UV which was initiated on May 20, 2005 arrived mid July 2005. The UV levels are declining.


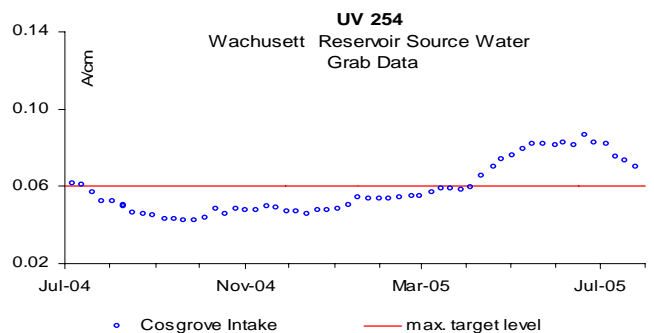


Source Water – Turbidity and Algae Results July 2005

Source Water – Turbidity Results

Turbidity is a measure of suspended and colloidal particles including clay, silt, organic and inorganic matter, algae and microorganisms. The effects of turbidity depend on the nature of the matter that causes the turbidity. High levels of particulate matter may have a higher chlorine demand or may protect bacteria from the disinfectant effects of chlorine, thereby interfering with the disinfectant residual throughout the distribution system.



Samples for turbidity from Quabbin Reservoir are collected at the Ware Disinfection Facility before chlorination. Samples from Wachusett Reservoir were taken at Wachusett Intake before chlorination from November 1, 2003 to March 16, 2004, October 26, 2004 and November 13, 2004 to December 10, 2004. Otherwise, samples were taken at the Cosgrove Intake before chlorination. The Massachusetts Department of Environmental Protection standard for source water turbidity for unfiltered water supply systems is a maximum of 1.0 NTU; the EPA standard is a maximum of 5.0 NTU. Maximum turbidity results at Quabbin and Wachusett were within DEP standards for the month.

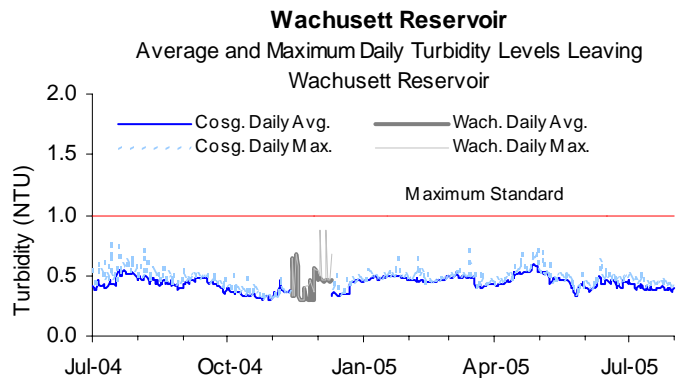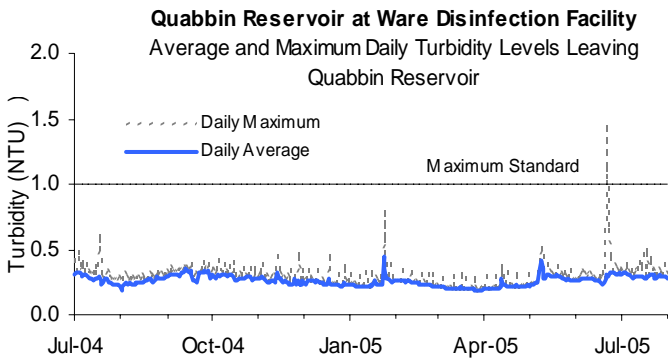

Source Water – Algae Results

Algal levels in reservoirs are monitored by DCR and MWRA. These results, along with taste and odor complaints, are used to make decisions on source water treatment for algae control. Most taste and odor complaints at the tap are due to algae, which originate in source reservoirs, typically in trace amounts. Occasionally, a particular species grows rapidly, increasing its concentration in water. When *Synura*, *Anabaena*, or other nuisance algae blooms, MWRA may treat the reservoir with copper sulfate, an algicide.

The Wachusett Reservoir was treated with copper sulfate on July 22 and 26 to control the growth of *Chryso-sphaerella*, a taste and odor causing algae species. Of the 53 water quality complaints received during July from local water departments, nineteen concerned taste and odor that may be due to the algae. Complaints appeared to drop off once ozone treatment at the Carroll Water Treatment Plant went on-line July 27.

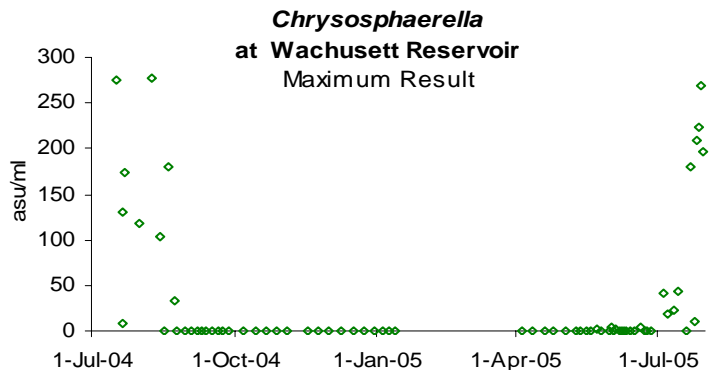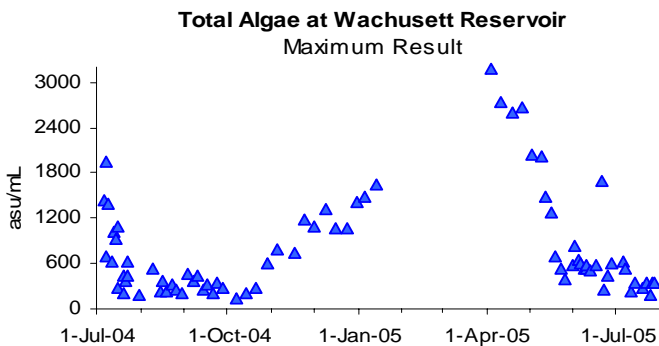

Treated Water – Disinfection, pH and Alkalinity Results

July 2005



Treated Water - Primary Disinfection

MWRA provides disinfection adequate to achieve EPA's requirement of 99.9% inactivation of *Giardia* cysts and 99.99% inactivation of viruses in drinking water using a calculation based on three sample points that DEP approved in June, 1999. Depending on the number of sample points that are providing accurate information, CT may be reported on one, two or three points.

CT achievement for *Giardia* assures CT achievement for viruses, which have a lower CT requirement. The concentration (C) of the disinfectant in the water over time (T) yields a measure of the effectiveness of disinfection, CT. The required CT varies with disinfectant type, water temperature, pH, and other factors. MWRA calculates daily CT inactivation rates at maximum flow, as specified by EPA regulations.



Wachusett Reservoir - MetroBoston Supply:

Chlorine dose at the Cosgrove Disinfection Facility (CDF) varied between 1.9 to 2.2 mg/L. On July 27, the Carroll Water Treatment Plant (CWTP) was activated. This facility uses ozone instead of chlorine for primary disinfection. The CDF was officially shutdown July 30. Ozone dose at CWTP varied between 1.4 to 2.4 mg/L. CT was met each day in July, as well as every day for the last year. CT calculations for *Giardia* is much more conservative at the Carroll Water Treatment Plant; subsequently more inactivation occurs than is being accounted for.

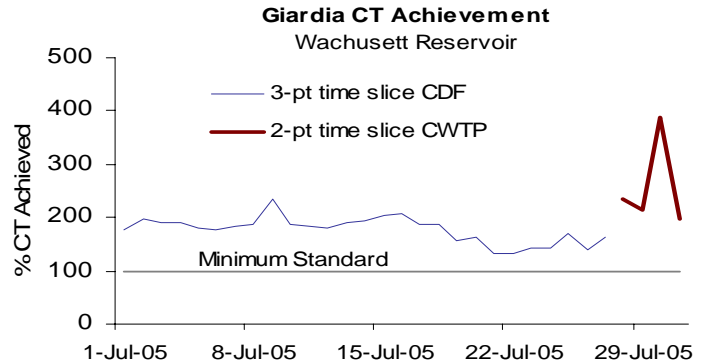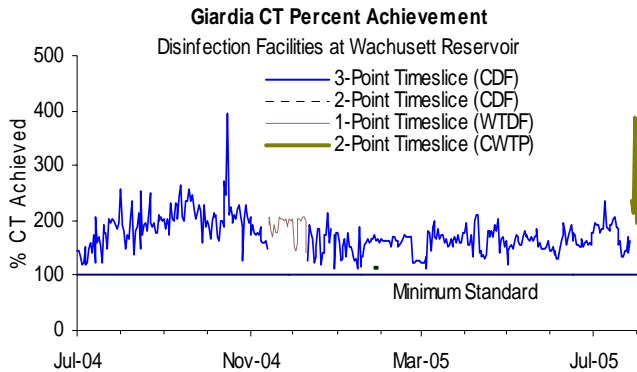



Quabbin Reservoir at Ware Disinfection Facility (CVA Supply):

Chlorine dose remained at 1.3 mg/L. CT was met each day in July, as well as every day for the last year.

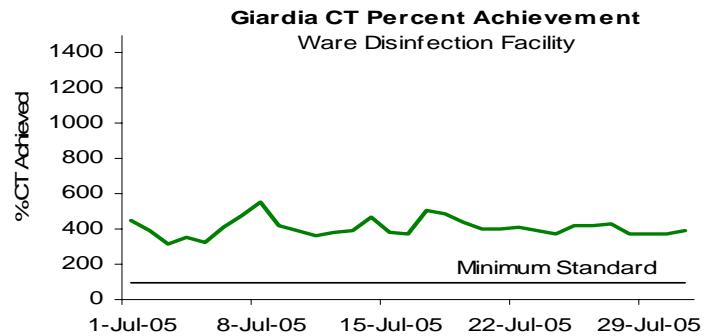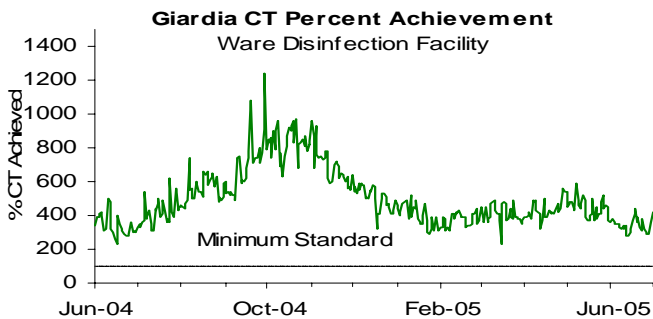

Treated Water – pH and Alkalinity Compliance

MWRA adjusts the alkalinity and pH of Wachusett water to reduce its corrosivity in order to minimize the leaching of lead and copper from service lines and home plumbing systems into the water. MWRA's target for distribution system pH is 9.1 and alkalinity is 40 mg/l. Beginning January 1, 2005, as per DEP requirements, samples from Shaft 9A have a minimum compliance level of 8.9 for pH and 37 mg/L for alkalinity. Samples from 27 community taps have a minimum compliance level of 8.8 for pH and 37 mg/L for alkalinity. For no more than nine days in a six-month period may results be below these levels. Quality Assurance and operator staff test pH and alkalinity daily at Shaft 9A. Community samples are collected on a quarterly basis. Four communities had their pH collected July 29 to August 2 as part of the monitoring program for the startup of the Carroll Water Treatment Plant. See Table below for July 29 to July 31 results. In July, no sample results were below these levels. Compliance is based on results for a 6-month period (January to June and July to December).

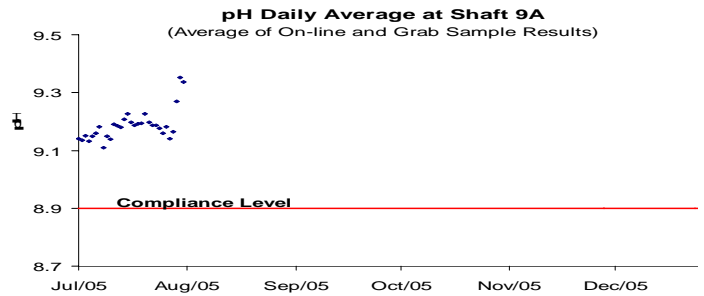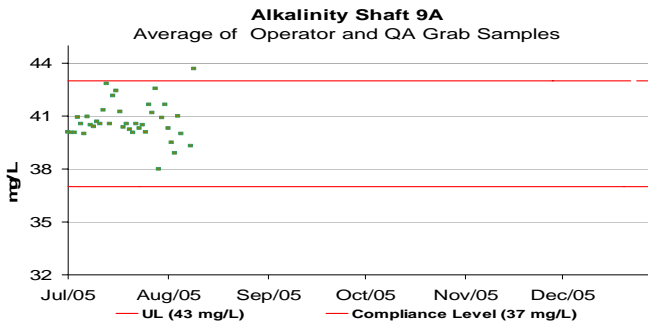

Community Requirements

Minimum Level for pH = 8.8

Minimum Level for Alkalinity = 37 mg/L

STARTUP TESTING		PARAMETERS	
DATE	SAMPLE SITE ADDRESS/ LOCATION	PH* (S.U)	ALKALINITY (MG/L)
29-Jul	Boston Fire Station, 1940 Centre Street, West Roxbury	9.1	NS
29-Jul	Boston, 59 Fenway, Texaco Station	8.9	NS
29-Jul	Boston, 9 Gallivan Boulevard, Dorchester	8.9	NS
29-Jul	Boston, 200 Cambridge St.	8.8	NS
30-Jul	Boston Fire Station, 1940 Centre Street, West Roxbury	9.2	NS
30-Jul	Boston, 59 Fenway, Texaco Station	9.2	NS
30-Jul	Boston, 9 Gallivan Boulevard, Dorchester	9.3	NS
30-Jul	Boston, Government Center Fire Station, 200 Cambridge St.	9.3	NS
31-Jul	Boston, 59 Fenway, Texaco Station	9.3	NS
31-Jul	Boston, Government Center Fire Station, 200 Cambridge St.	9.3	NS
Number of Days of Excursion (July 1, 2005 to December 31, 2005)			
Date of Excursion		Number of Days with Excursions	
N/A		None	None
Total Number of Days with Excursion		N/A	

* = Average of duplicate results

NS= No Sample Taken

Bacteria & Chlorine Residual Results for Communities in MWRA Testing Program July 2005

While all communities collect bacteria samples for the Total Coliform Rule (TCR), 37 systems (including Deer Island and Westboro State Hospital) use the MWRA's Laboratory for TCR compliance testing. These systems collect samples for bacteriological analysis and measure water temperature and chlorine residual at the time of collection. The other 9 MWRA customer communities (including Lynn's GE plant) have their samples tested elsewhere and these towns should be contacted directly for their monthly results.

There are 141 sampling locations for which MWRA is required to report TCR results. These locations include a subset of the community TCR locations as well as sites along the MWRA transmission system, water storage tanks and pumping stations.

The Safe Drinking Water Act (SDWA) requires that no more than 5% of all samples may be total coliform positive in a month (or that no more than one sample be positive when less than 40 samples are collected each month). Public notification is required if this standard is exceeded.

Escherichia coli (*E.coli*) is a specific coliform species that is almost always present in fecal material and whose presence indicates likely bacterial contamination of fecal origin. If *E. coli* are detected in a drinking water sample, this is considered evidence of a critical public health concern. Additional testing is conducted immediately and joint corrective action by DEP, MWRA, and the community is undertaken. Public notification is required if follow-up tests confirm the presence of *E. coli* or total coliform. MWRA considers a disinfectant residual of 0.2 mg/L a minimum target level at all points in the distribution system.

Highlights

Eleven of the 1,708 community samples (0.64%) system-wide tested positive for confirmed total coliform during the month of July. Westborough State Hospital and Southborough failed the TCR for July. None of the 608 MWRA samples (0.0%) tested positive for confirmed total coliform. No samples tested positive for *E. coli*. All thirty-seven systems that submitted chlorine residual data maintained an average disinfectant residual of at least 0.2 mg/L. 2.4% of the system samples had a disinfectant residual lower than 0.2 mg/L.

Town	Samples Tested for Coliform (a)	Total Coliform # (%) Positive	E.coli % Positive	Public Notification Required?	July 2005 Minimum Chlorine Residual (mg/L)	July 2004 Minimum Chlorine Residual (mg/L)	July 2005 Average Chlorine Residual (mg/L)	July 2004 Average Chlorine Residual (mg/L)
ARLINGTON	56	0 (0%)			0.03	0.04	0.66	0.63
BELMONT	32	0 (0%)			0.04	0.13	0.94	1.03
BOSTON	223	0 (0%)			0.34	0.31	1.20	1.18
BROOKLINE	68	0 (0%)			0.84	0.91	1.39	1.36
CHELSEA	32	0 (0%)			0.83	0.44	1.30	1.08
DEER ISLAND	16	0 (0%)			0.51	0.06	1.10	0.91
EVERETT	40	0 (0%)			0.43	0.54	0.85	1.00
FRAMINGHAM (c)	72	0 (0%)			0.20	0.11	1.21	1.04
LEXINGTON	36	0 (0%)			0.55	0.17	1.31	1.15
LYNNFIELD	6	0 (0%)			0.22	0.67	0.88	0.88
MALDEN	60	0 (0%)			0.79	0.74	0.92	0.88
MARBLEHEAD	24	0 (0%)			0.27	0.21	1.11	1.02
MARLBOROUGH (b)(c)	56	1 (1.79%)		no	0.08	0.04	0.82	0.71
MEDFORD	68	0 (0%)			0.40	0.23	1.14	1.06
MELROSE	36	0 (0%)			0.03	0.03	0.65	0.62
MILTON	31	0 (0%)			0.10	0.28	0.97	1.02
NAHANT	10	0 (0%)			0.04	0.30	0.73	0.60
NEEDHAM (b)	41	0 (0%)			0.10	0.06	0.66	0.57
NEWTON	88	0 (0%)			0.28	0.22	1.26	1.13
NORTHBOROUGH	16	0 (0%)			0.47	0.15	1.23	1.24
NORWOOD	36	0 (0%)			0.04	0.02	0.80	0.71
QUINCY	92	0 (0%)			0.06	0.10	1.05	1.04
REVERE	55	0 (0%)			0.54	1.00	1.12	1.29
SAUGUS	32	0 (0%)			1.05	1.02	1.15	1.13
SOMERVILLE	80	0 (0%)			0.10	0.02	1.14	0.91
SOUTHBOROUGH (c)	20	3 (15.00%)		yes	0.10	0.12	0.63	0.70
STONEHAM	28	0 (0%)			0.60	1.02	1.29	1.56
SWAMPSCOTT	18	0 (0%)			0.65	0.19	0.99	0.82
WAKEFIELD (b)	44	0 (0%)			0.43	0.17	0.91	0.79
WALTHAM	68	0 (0%)			0.03	0.10	0.99	0.93
WATERTOWN	40	0 (0%)			0.17	0.23	0.91	1.02
WELLESLEY (b)	37	1 (2.70%)		no	0.06	0.09	0.56	0.47
WESTBORO HOSPITAL	27	6 (22.22%)		yes	0.02	0.10	0.14	0.40
WESTON (c)	16	0 (0%)			0.06	0.04	0.69	0.63
WINCHESTER (b)	20	0 (0%)			0.08	0.05	0.77	0.57
WINTHROP	24	0 (0%)			0.50	0.17	1.20	1.01
WOBBURN (b)	60	0 (0%)			0.16	0.10	0.85	0.71
Total:	1708	11(0.64%)						
MASS. WATER RESOURCES AUTHORITY (d)	608	0 (0%)			0.03	0.02	1.19	1.11

(a) The number of samples collected depends on the population served and the number of repeat samples required.

(b) These communities are partially supplied, and may mix their chlorinated supply with MWRA chloraminated supply.

(c) These communities locally chloraminate.

(d) MWRA sampling program includes a subset of community TCR sites as well as sites along the transmission system, tanks and pumping stations. Some MWRA TCR sites which are entry points to the community had low chlorine residuals due to various reasons.

Treated Water - Disinfection By-Product (DBP) Levels in Communities









July 2005

Total Trihalomethanes (TTHMs) and Haloacetic Acids (HAAs) are by-products of disinfection treatment with chlorine. Chlorination levels, the presence of organic precursors, pH levels, the contact time of water with chlorine used for disinfection, and temperature all affect TTHM and HAA levels. DBPs are of concern due to their potential adverse health effects at high levels. EPA's running annual average standards are 80 ug/L for TTHMs and 60 ug/L for HAA5. DEP requires that compliance samples be collected quarterly. MWRA samples weekly at some locations, monthly and quarterly at others. **Metro Boston numbers from the fully-served communities are used for compliance purposes**; results presented below from CVA and MetroWest sampling sites enable MWRA staff to monitor MWRA treatment processes. Individual CVA and MetroWest communities are responsible for their own compliance monitoring and reporting. They must be contacted directly for their results. With the startup of the Carroll Water Treatment Plant and the consolidation of treatment in Marlborough, MetroWest sampling will be consolidated with MetroBoston. This will be reflected in compliance data beginning this quarter.

The running annual average for TTHMs and HAA5s at compliance locations, represented in the top two graphs below, remained below current standards. Average monthly HAA5 and TTHM levels at all sampling locations for the MetroWest and Metropolitan Boston communities are higher than those of last year. The increase in UV and Total Organic Carbon levels (indicators of organic precursors) found in the Wachusett Reservoir and the high flows to support the testing at the Carroll Water Treatment Plant all contribute to the elevated DBP levels. See UV graph on the bottom right of Page 3. The transfer of the Quabbin Reservoir water to the Wachusett Reservoir to lower the UV arrived mid July. With the activation of the Carroll Water Treatment Plant on July 28 and the arrival of the Quabbin water, the DBP levels will drop dramatically. Initial August sampling indicates reductions of over 80%.

TOTAL TRIHALOMETHANES

HALOACETIC ACIDS

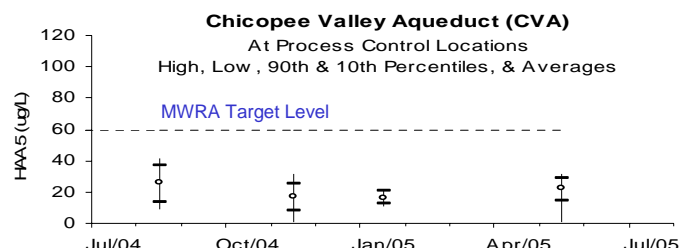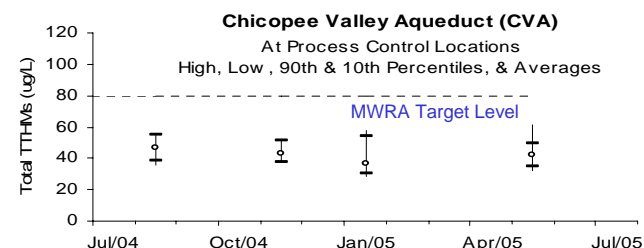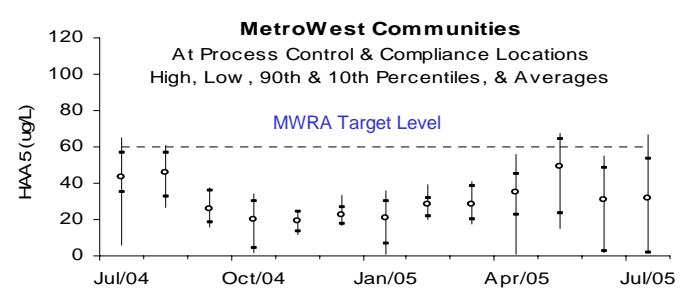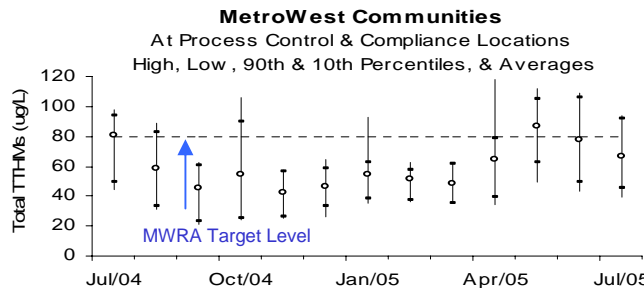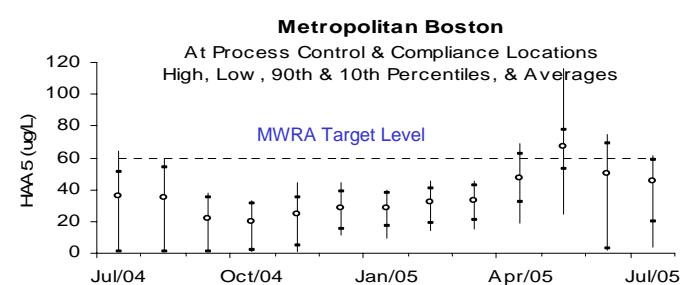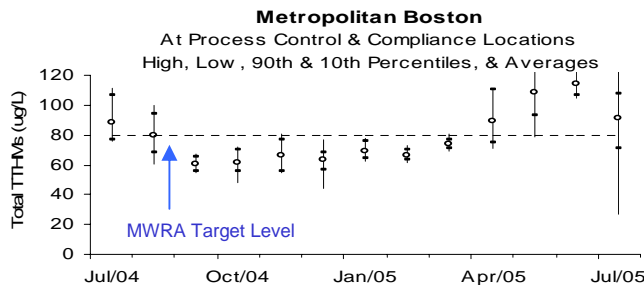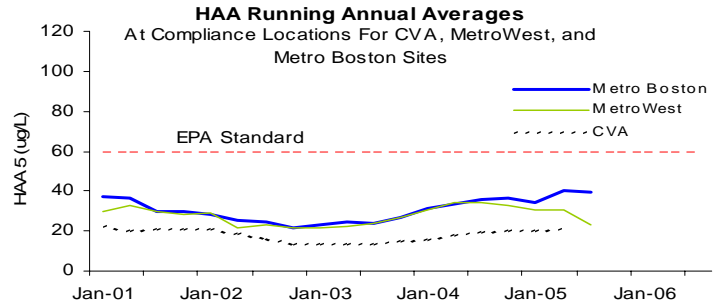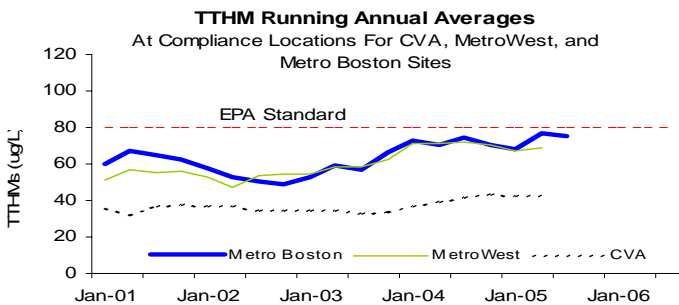

MWRA Monthly Water Quality Analysis

July 2005

This page provides information on water quality at six locations in the MWRA transmission system. Results reflect a "snapshot" in time and may not represent typical conditions. Elevated levels of a particular parameter may occur from time to time. MWRA staff review these numbers carefully and follow-up unusual results by re-analyzing samples, collecting new samples, or auditing sample sites. More rigorous daily or weekly monitoring of select parameters at these and other locations provides a better overall picture of water quality and is reported for some parameters elsewhere in this document. Monitoring for parameters indicated in bold is quarterly, as they either (1) have minimal variability or (2) are always below detection levels.

Component	CVA System			Metropolitan Boston			I Standards		
	Quabbin Reservoir at Ware	Ludlow Monitoring Station	Wachusett Reservoir at Cosgrove	ICC Marlboro (Treated)	Comm Ave., Newton (Treated)	Shaft 9A, Malden (Treated)	Standard	Units	Exceedance
Alkalinity	2.8	4.0	5.8	38.0	39.4	40.3		MG/L	
Aluminum	< 15.0	< 15.0	16.4	18.6	18.5	20.6	50-200 (e)	UG/L	NO
Ammonia-N	0.01	0.01	0.03	0.02	0.25	0.27		MG/L	
Antimony	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	6 (a)	UG/L	NO
Arsenic	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	50 (a)	UG/L	NO
Barium	6.4	6.4	10.3	10.4	10.4	10.2	2000 (a)	UG/L	NO
Beryllium	< 0.3	< 0.3	< 0.3	< 0.3	< 0.3	< 0.3	4 (a)	UG/L	NO
Bromate	< 2.5	< 2.5	< 2.5	< 2.5	< 2.5	< 2.5	10 (a)	UG/L	NO
Bromide	9.9	<i>Inv Res</i>	18.4	9.5	7.4	7.8		UG/L	
Cadmium	< 0.5	< 0.5	< 0.5	< 0.5	< 0.5	< 0.5	5 (a)	UG/L	NO
Calcium	2100	2160	4850	4820	4870	4840		UG/L	
Chloride	7.9	9.2	26.6	27.9	29.3	28.9	250 (e)	MG/L	NO
Chlorine, Free	NS	0.75	NS	0.47	NS	NS	4 (c)(d)	MG/L	NO
Chlorine, Total	NS	NS	NS	NS	1.6	1.5	4 (c)(d)	MG/L	NO
Chromium	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	100 (a)	UG/L	NO
Coliform, Fecal, MF Method	0	NS	0	NS	NS	NS	20 (b)	CFU/100 mL	NO
Coliform, Total, MF Method (h)	0	0	0	0	0	0	100 (b) 0 (c)	CFU/100 mL	NO
Copper **	< 3.0	< 3.0	4.0	5.7	4.2	6.6	1300 (f) 1000 (g)	UG/L	NO
Cyanide	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.2 (a)	MG/L	NO
Fluoride	< 0.02	< 0.02	< 0.02	1.07	1.07	1.12	4 (a)	MG/L	NO
Hardness	7.3	7.4	15.8	15.7	15.8	15.6		MG/L	
Iron **	7.2	< 6.0	39.1	40.6	43.6	47.7	300 (e)	UG/L	NO
Lead	< 1.2	< 1.2	< 1.2	< 1.2	< 1.2	< 1.2	15 (a)	UG/L	NO
Magnesium	497	494	899	892	886	866		UG/L	
Manganese	2.7	2.4	7.4	9.2	9.9	7.1	50 (e)	UG/L	NO
Mercury	< 0.010	< 0.010	< 0.010	< 0.010	< 0.010	< 0.010	2 (a)	UG/L	NO
Nickel	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		UG/L	
Nitrate-N	< 0.005	< 0.005	0.118	0.112	0.117	0.105	10 (a)	MG/L	NO
Nitrite	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	1 (a)	MG/L	NO
Orthophosphate	< 0.003	< 0.003	0.004	0.011	0.012	0.012		MG/L	
pH	7.4	7.0	6.6	6.9	9.2	9.2		S.U.	
Potassium	554	624	1030	1060	1060	1050		UG/L	
Selenium	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	50 (a)	UG/L	NO
Silica (SiO2)	1960	2020	3060	3430	3470	3400		UG/L	
Silver	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	100 (e)	UG/L	NO
Sodium	4.9	5.9	15.3	31.9	32.7	32.6		MG/L	
Specific Conductance	48	53	129	195	199	199		UMHO/cm	
Standard Plate Count, HPC (48 Hrs @ 35C)	NS	NS	160	18	1	1	500 (c)	CFU/mL	NO
Sulfate (SO4)	5.0	5.0	7.0	7.0	7.0	6.9	250 (e)	MG/L	
Thallium	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	2 (a)	UG/L	NO
Total Dissolved Solids	55	41	98	136	122	114	500 (d)	MG/L	
Total Organic Carbon	2.1	2.1	2.8	3.1	2.9	3.5		MG/L	
Total Phosphorus	0.010	0.010	0.009	0.015	0.016	0.016		MG/L	
UV-254	0.026	0.020	0.082	0.055	0.065	0.064		A	
Zinc **	3.3	3.1	1.8	2.0	2.2	1.9	5000 (e)	UG/L	NO

(a) = Primary MCL standard (health related). DEP "Drinking Water Regulations", 310CMR 22.00.

(b) = Primary MCL standard (health related), applies to source (raw) water only. DEP "Drinking Water Regulations", 310CMR 22.00.

(c) = Primary MCL standard (health related). DEP "Drinking Water Regulations", 310CMR 22.00. Applies to samples of treated water downstream of Wachusett and Quabbin Reservoirs.

(d) = Maximum Residual Disinfectant Level. DEP "Drinking Water Regulations", 310CMR 22.00.

(e) = Secondary MCL standard (aesthetic related). DEP "Drinking Water Regulations", 310CMR 22.00.

(f) - Refers to 90th percentile Action Level

(g) - Refers to a single sample, secondary MCL

(h) - Confirmed results only are reported

MCL = Maximum Contaminant Level

CFU = Colony Forming Unit

S.U. = Standard Units

UG/L = micrograms per liter = parts per billion

NS = No sample

NTU = Nephelometric Turbidity Unit

MG/L = milligrams per liter = parts per million

< = less than method detection limit

HPC = Heterotrophic Plate Count

Inv Res = Invalid sample result

** = Metal results may be elevated due to local plumbing at the sample tap.

Bold Italics = Quarterly Samples

Most results are based on single grab samples collected on July 5, 11 and 13, 2005 and analyzed by MWRA and contract laboratories.

NOTE: MWRA tests for cadmium and mercury are more sensitive than the EPA-set levels of detection and reporting. For cadmium any level below 1.0 ug/L and for mercury any level below 0.2 ug/L are under the EPA minimum detection limits. MWRA will continue to report any result below these detection limits here in the monthly report but will follow EPA reporting requirements and not report them in the EPA-regulated annual Consumer Confidence Report.

The July bromide result for Ludlow Monitoring Station was invalidated by the testing laboratory.